

DF 110

Detector of refrigerant gases and hydrogen (H₂)



KEY POINTS

- Detection of all the HCFC and HFC refrigerants
- Detection of mixtures 5% hydrogen - 95% nitrogen (Nidron 5...)
- Heated diode sensor
- 3 modes of sensitivity (high, low and normal)
- Manual and automatic autozero

TECHNICAL FEATURES

Detected gases	HFC : R134a, R404a, R407c, R410a, R32, R422a/b/c/d, R425a, R507a, R125 HCFC : R22 CFC : R12 et R502 Others : H ₂ , R290, R600a, HFO-1234yf
Measuring element	Semi-conductor sensor
Display	13 leds : - 8 for the graphic visualization of thresholds - 3 for the sensitivity of detection - 2 for the battery level and manual autozero
Indication	LED : gradual lighting up when the gas concentration increases Audible : the beep frequency increases when the gas concentration increases
Probe	Flexible, 300 mm length
Autonomy	> 12 hours
Housing	Anti-choc ABS, protection IP54
Keypad	3 keys
European directives	2004/108/EC EMC ; 2006/95/EC Low Voltage ; 2011/65/EU RoHS II ; 2012/19/EU WEEE
Power supply	4 AAA LR03 1.5 V batteries
Ambiance	Neutral gas
Conditions of use (°C, %RH, m)	From 0 to +50 °C. In non condensing conditions. From 0 to 2000 m.
Storage temperature	From -20 to +80 °C
Auto-extinction	15 min
Weight	295 g

SPECIFICATIONS

Mode	Indicative measuring range (g/an)	Visual alarm
Low sensitivity ("B" on the device)	From 0 to 300 g/an	All the leds (8) for 300 g/an
Normal sensitivity ("Norm" on the device)	From 0 to 30 g/an	All the leds (8) for 30 g/an
High sensitivity ("H" on the device)	From 0 to 3 g/an	All the leds (8) for 3 g/an




REGLEMENTATIONS

The refrigerant gas detector complied with the EN 14624 standard that determines the following points :

- **Minimum threshold of sensitivity :**
Fixed : < 1 g / year at 3 mm
In moving air : 2 g / year, 2 cm / s at 3 mm
- **Minimum time of detection (1 g / year) :** 1 second
- **Autozero :** 2 seconds
- **Recuperation time after exposition :** from 1 to 10 seconds (depending on detection level and threshold of sensitivity)

SIZE

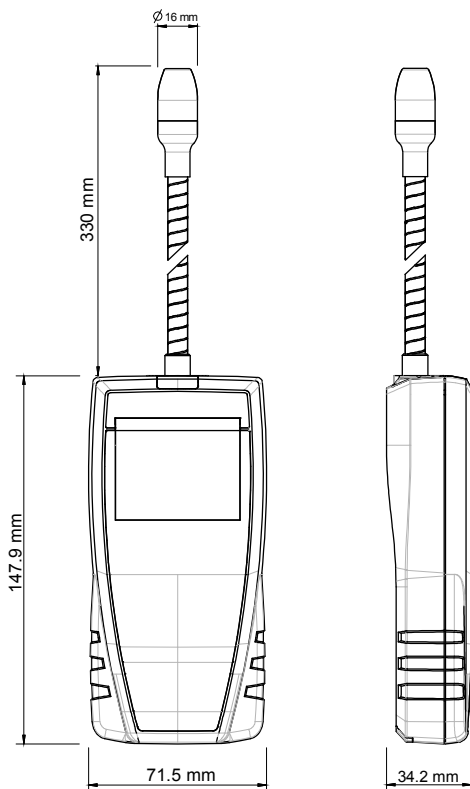

MAINTENANCE

We realise the check, adjustment and maintenance of your devices to guarantee a constant quality level of your measurements. According to the quality assurances standards, we recommend a yearly checking. The check of the detector at the sensitivity threshold of 5 g / year is carried out according to the decree of the 7th may 2007 n°2007-737.

We recommend to check regularly that the nozzle of the detector and its filter are clean in order to guarantee the performances of the device.

WARRANTY

Instruments have 1-year guarantee for any manufacturing defect (return to our After-Sales Service required for appraisal).

SUPPLIED WITH

Devices are supplied with :

- Verification certificate
- Transport case
- Test sample containing refrigerant gas
- Filter



ACCESSORIES

CQD : Magnetic protective housing



MT 51 : ABS transport case



www.kimo.fr

Distributed by :



EXPORT DEPARTMENT

Tel : + 33. 1. 60. 06. 69. 25 - Fax : + 33. 1. 60. 06. 69. 29

e-mail : export@kimo.fr